

# Badminton





## Introduction

This Design Guidance has been written specifically with Badminton as the primary consideration. The modern game demands special playing conditions that many halls could easily have provided at the design stage but which would now be expensive to alter. Although some technical terms are used throughout this document they have been kept to the minimum so that the professional designer and the club player can both gain from this information.

Badminton is one of the most popular sports in the U.K. and is frequently the single most popular sport in multi-sport halls. Sports halls are often built using the badminton courts as a standard to produce the size of the building i.e. a four-court hall will accommodate other sports within this area such as netball, basketball, five-a-side football, volleyball and cricket practice nets.

Badminton has the most exacting visual requirements therefore the section on lighting is more detailed than other sections. Badminton requires that players are able to sight a fast moving shuttlecock against a suitable background, which can be varied by lighting and colour. Badminton requires space and “run-off” similar to other sports but requires different lighting and greater height than most other sports. Badminton requires a properly lit hall

with no natural daylight and a suitable background for sighting the shuttle. The hall should be warm with controlled ventilation and a resilient floor to prevent injuries.

Note - Contact the BADMINTON England, Development Department, National Badminton Centre, Bradwell Road, Loughton Lodge, Milton Keynes, MK8 9LA. Tel: 01908 268400.

In accordance with the Badminton Facilities Strategy, BADMINTON England has introduced criteria for **High Performance Centres, Performance and Development Centres and Development Centres**. It has also introduced an accreditation system for special badminton centres, which enables any sports centre to be assessed by the BADMINTON England and if it achieves the required standard, is awarded an accreditation as a specialist badminton centre in one of the above three categories.


This Design Guidance is written in two sections A and B:

**Section A** covers dedicated badminton halls, where no other sport is played and would normally be a High Performance Centre or a Performance and Development Centre.

**Section B** covers multi-use halls in which badminton is played together with other sports and community activities. These may be Performance and Development Centres and Development Centres.

**Table 1 Definitions of hall use**

Performance	Definition	Levels of play
CLASS 1	High Performance Centre	Suitable for competitive play and training up to National level
CLASS 2	Performance & Development Centre	Suitable for competitive play and training up to Junior National and Senior County
CLASS 3	Development Centre	Suitable for competitive play and training up to Junior County, Local League/Club and Recreational play

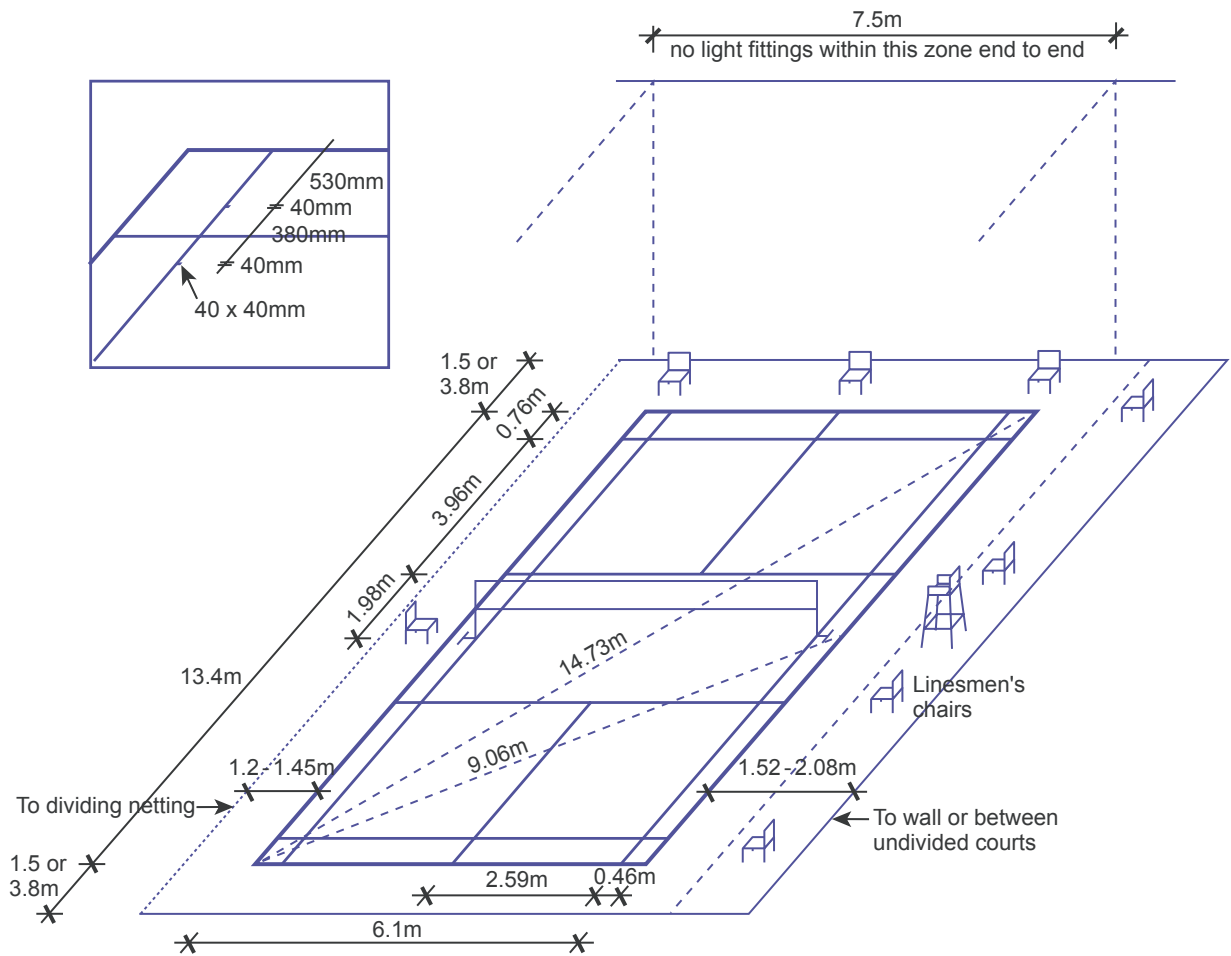

**Figure 1 Badminton Court space requirements – Inset detail of corner markings**

## Section A Dedicated Badminton Centres

These centres will be to the highest standard and will have to comply specifically with the requirements of Badminton England as set out below.

### A1 - Flooring

- 1) The preferred flooring for playing badminton is a sprung floor covered with a vinyl absorbent covering. This is an area elastic floor covered with a point elastic covering; and is referred to as a floor with combi-elastic deflection. A description of this floor would be as follows:-

A combined area and point elastic sports floor comprising a 22mm thick plywood decking secured to preservative treated battens supported by shock absorbent cradles. The playing surface is to comprise a 6.5mm thick close cell foam backed sheet floor covering.

- 2) The other type of sprung floor commonly used and accepted by BADMINTON England is a sprung floor covered with hardwood strip flooring.
- 3) The performance standard and testing method for sports floors is covered by British Standard 7044: *Artificial Sports Surfaces, Part 4 – Specification for Surfaces for Multi-sports Use*. CEN 217 is a



Figure 2 General indicative standard

preferred but higher standard and is more relevant to the higher standards of play and competition. This is a wide specification and BADMINTON England prefers to be more specific in the type of floor used. A more detailed Performance Specification for Badminton Flooring is set out at Appendix 1 of this Design Guidance.

- 4) The finish to the flooring should be matt to avoid any glare and the overall effect dark in colour. The floor colour's reflectance value should be within 20 to 40%.

### A2 - Space and layout

#### Schedule of court sizes

The schedule of sizes in Table 1 are for a four-court hall but some centres may have more courts in which case the minimum dimensions and spaces should be maintained.

#### Height requirements

The heights indicated in the schedule are the minimum heights, which should be over the whole of the court area, and are below any obstructions such as beams, basketball backboards, cricket net rails and lights, etc.

#### Layout of courts

- 1) Court markings should be 40mm wide and should be of a contrasting colour to the floor but it is usual for these lines to be matt white; they may be applied by paint or tape.
- 2) Should the courts be laid out "end to end" then there should be a curtain between the ends of the courts and it is essential that the minimum dimension is maintained on both sides of the curtain (i.e. 2.3metres). To avoid any distractions caused by movement and lights from the other courts, the curtain dividing the courts **should be solid**; netting will not be sufficient.

Note - Full details of the layout of a badminton court may be obtained on BADMINTON England's website [www.badmintonengland.co.uk](http://www.badmintonengland.co.uk) (click on Development and then Facilities)

**A3 - Walls and ceilings**

**Walls**

- 1) A background against which a fast moving shuttle can be seen easily is critically important for the successful playing of the game.
- 2) The ideal badminton hall has four plain walls with no windows or roof lights. There should be no distracting attachments, particularly brightly coloured items. There should be no ledges or other projections likely to trap shuttles. The surface material, texture colour and reflectance must be consistent and uninterrupted over the full height of the Hall.
- 3) Very careful thought should be given to the design of spectator galleries, these can sometimes create difficulties and distractions when viewed from the court. These areas need to be of similar colour to the walls and the lighting should be subdued and carefully hidden when viewed from the court. Windows and doors at the rear of the spectators' galleries should be curtained or designed so that no light can be seen from the court. If the spectator areas are glazed then specialist advice should be obtained from the Glazing Association so that no

interference is caused by lights or reflection of activity from the playing area.

Note - Glass and Glazing Federation, 44, Borough High Street, London, SE1 1BX Tel: 0207 403 7177

- 4) Walls should be finished in medium to dark shades and have a matt surface. This applies just as much to sidewalls as to the end walls since many shots are played looking towards the side of the court. Walls can be built of many different types of material but it should be borne in mind that acoustics play an important part in the enjoyment of the hall. Colours with a reflectance value of 30-50% were found to give the best playing conditions - green (Dulux Colour dimensions code 30 GG 45/362) or an equivalent blue (86 BG 43/321). Any doors or coverings should be finished in the same colour as the walls.
- 5) Where curtains are drawn at the ends of the courts, such as in a hall that has the courts laid out "end to end", the material should be "solid" and the same colour as the surrounding walls.
- 6) The overall construction should be designed to provide sound absorption qualities with a **maximum** reverberation time of 2 seconds at 500Hz with a noise rating of 50.

**Table 2 High performance centre – minimum spaces around courts**

Hall size	Between courts	Between courts where curtain is required	Sides at end of hall	End of court
<b>New-build hall 9.1m high</b>				
Length 33.00m	No curtain 1.72m		1.72m	2.30m
Width 18.00m	With curtain 1.50m	2.60m	1.50m	
<b>Recommended new-build hall size for tournaments and accommodating spectators</b>				
Length 34.80m	No curtain 2.08m		2.08m	3.80m
Width 21.00m	With curtain 2.00m	3.20m	1.60m	
Notes:				
<ul style="list-style-type: none"> <li>● The dimension of 2.6m between courts is the recommended minimum when a curtain divides the courts; this maintains the 1.3m at the sides of each court affected.</li> <li>● The dimension of 3.8m at the ends of the court is when additional space can be provided for spectators. In this situation it is more practical to provide 2.3m at one end and 4.3m at the other end for spectator seating, circulation and umpires/linesman's chairs.</li> </ul>				

## Ceilings

The ceilings in sports halls are often the underlining to the roof, which is usually of a sandwich construction. The underlining can be of an acoustic material and as with the walls this is very important to the environment of the hall. Sometimes the self-finished acoustic lining is an ideal colour for the ceiling and complies with the required reflectance values of 70–90% - colours in excess of 90% i.e. white, causes visual problems and should not be used.

## A4 - Environmental services

### Lighting

- 1) Lighting for badminton, as with most other activities, involves subjective opinions that may fluctuate in respect of the degree of acceptability of a lighting installation. The aims and objectives in lighting a badminton court must take into consideration the requirements for provision of:
  - A safe environment for players.
  - An effective illumination of court markings so as to aid player information and to assist match officials in the execution of their duties.
  - A suitable and sufficient lighting for spectators.
- 2) In accordance with BS EN 12193 (1999) - Sports Lighting, three area dimensions are described i.e. principal area (PA), total area (TA) and reference area (RA). The principal area is the actual playing area required for the performance of a sport. The total area comprises the principal area plus any additional safety area outside the principal area. The reference area is that area on which the main lighting requirements apply.
- 3) The respective dimensions for badminton court lighting are given as PA = (13.4m x 6.1m) and TA (Max) = (18m x 10.5m).
- 4) When designing the lighting for badminton halls it is useful to appreciate how the game is played. The shuttle can move at very fast speeds over the net requiring maximum light reflecting from the white feathers of the shuttle. The shuttle can best be seen when illuminated in this way against a dark background, therefore the rear does not need to be lit to such a high level as the centre of the court; in fact very little lighting is required at the rear.
- 5) Players must be able to follow the flight of the shuttle against the background without being troubled by glare or having their attention distracted by bright light sources. Badminton requires very carefully designed lighting to enable the game to be played at a high standard. It is often thought that badminton requires very high illuminance levels but this is not the case, badminton requires lighting to be concentrated in certain areas but not in others.
- 6) Lighting is one of the most important requirements in the design of a hall where badminton is played but has so often been ignored. It is essential to consider lighting early in the design stage so that the lamp type can be co-ordinated with the court layout and the background colours. Lighting and colours should be considered as an entity.
- 7) Luminaires must not be directly positioned over the court. Doors and windows to other lit areas are all distracting, and arrangements should be made for such light sources to be temporarily screened or switched off.
- 8) It is important to appreciate that the background and the lighting should be considered as an entity as both can alter the playing conditions. The walls need to be of a colour giving a reflectance value (RV) of not more than 50% and the ceilings 70% – 90%. It has been found that not all colours give the best background, even when all colours selected were 50% RV; green and blue were the preferred colours. With regard to the ceiling the reflective value may be higher if the luminaires are suspended further from the ceiling - alternatively if the luminaries are positioned nearer to the ceiling then the ceiling fabric must be darker with a lower reflectance value.



- 9) The shuttle is also hit very high and over some distance, which demands a degree of uplighting to pick up the shuttle in flight. Preferred lighting conditions are obtained when the luminaires are suspended from the ceiling, as much of the game is spent with the players looking up at the ceiling to follow the flight of the shuttle.
- 10) The luminaires should be set at 5 metres from the floor and no closer than one metre from the side of the court. Luminaires should be concentrated from the midcourt to the centre; one positioned level with the net and the others positioned three metres in both direction and level with the midcourt area (see diagram figure 7). This layout has been proven to give suitable playing conditions and avoids situations where a player may be dazzled.
- 11) It is important that an appropriate type of luminaire is selected that allows a degree of shielding and/or diffusion to prevent the player looking into a direct light. Good lighting conditions have been obtained by using compact fluorescents – high frequency luminaries.
- 12) If a curtain is used between the courts then lighting is required on both sides of the curtain to maintain the same level of lighting.

#### **Illuminance to BS EN 12193 (1999)**

The level of illuminance required for many sports is influenced by the standard of play and is set out in BS EN 12193 (1999) as Class I, II and III. Notwithstanding this recommendation the level of illuminance required for badminton should be the best possible irrespective of standard of play. The illuminance plot at Table 3 shows the recommended level.

BADMINTON England recognizes that the National Governing Body's recommendation for lighting is not in accordance with BS EN 12193. Nevertheless, experience gained over many years supports the recommendation that lighting for Badminton should be in accordance with the illuminance levels as shown at Figure 4. This diagram shows there is not a uniformity of



**Figure 3 The luminaire positions**

lighting across the court but rather a higher level of lighting over the centre area of the court across the full width.

#### **Luminaires and glare control**


- 1) The total elimination of glare in sport is seldom achieved due to the ever-changing directions of view of participants. Nevertheless measures should be taken in an attempt to minimise glare that may affect the visual performance of participants. To this end downlighter luminaires should be used that incorporate glare control.
- 2) In sporting environments similar to indoor working conditions, glare should be calculated using the unified glare rating (UGR) method and limiting values used shall be those specified in prEN 12464.

Typical lux readings for a dedicated badminton court – luminaires to be 5 metres above floor level, 1 metre from the edge of the court and no luminaires extending more than 3 metres from the net line at the centre of the court.



**Table 3 Illuminance levels**

ILLUMINANCE PLOT with luminaires at 5m above floor level	
Average illuminance	474 lux
Minimum illuminance	305 lux
Maximum illuminance	595 lux

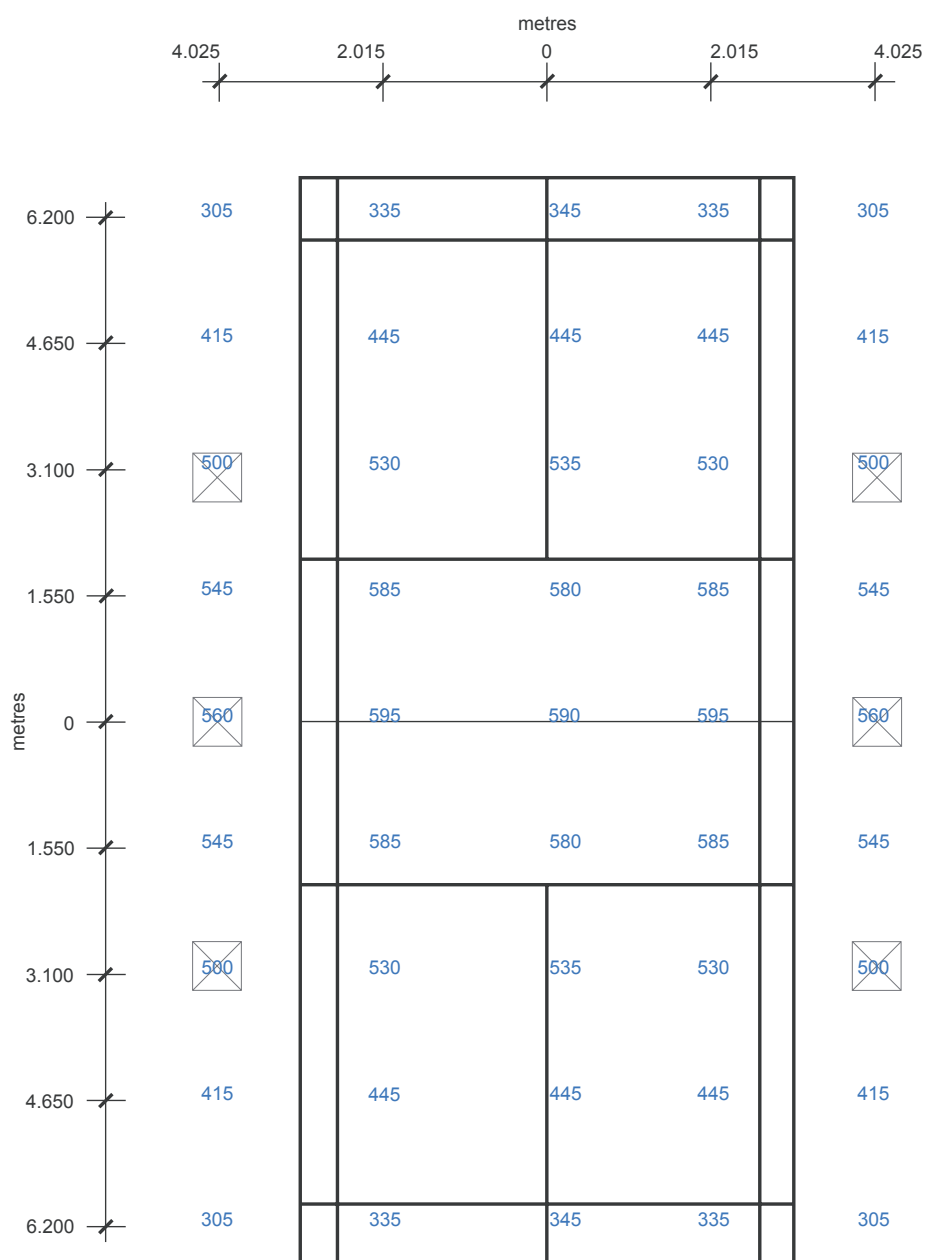

**Figure 4 Illuminance plot and luminaire positions**

### Maintenance and monitoring

A programme of cyclic maintenance should be operated whereby:

- Luminaires shall be cleaned at a frequency in keeping with the activities performed within the environment.
- Lamps should be changed in accordance with manufacturers' recommendations.
- Records shall be kept of maintenance performed.
- Individually failed lamps shall be replaced as a matter of urgency – since an inoperative luminaire will present a 'dark patch' when players are looking upwards which is likely to result in difficulty in following the trajectory and velocity of the shuttle.

### Heating and ventilation

- 1) The design temperatures should be between 16 to 19°C, which is accepted as the comfort zone for playing the game. It is recommended that no less than 1.5 air changes per hour be made.
- 2) Any heating or ventilating system that moves the air can deflect the shuttlecock; therefore it is important that heating and ventilation systems are designed taking this into account. The location and protection of all air input and extraction grilles or openings must be carefully considered – particularly in relation to the flight path of the shuttlecock. It is better if ventilation



**Figure 5 Note high-level radiant heaters on walls and extract fans at ends of building**

systems are designed to operate around the perimeter of the hall to limit air movement over the court. The air velocities within the playing area should not exceed 0.1 metres per second.

- 3) The system most commonly used where badminton is played is high-level radiant panels fitted to the walls in conjunction with a controlled ventilation system. Traditional low pressure hot water radiator systems or under floor heating could be used if appropriate to the type of flooring. Heating by warm air is not recommended, as it is difficult to control the air movement when the heating is operating.

### A5 - Other accommodation and facilities

Badminton does not require large storage facilities for equipment in dedicated badminton centres as the posts and nets are permanently positioned in the floor of the hall. The only other items of equipment may be shuttles and umpires chairs.

Other facilities required are as follows:

- Changing rooms with showers for both male and female \*
- Restaurant
- Physio/medical room
- Meeting/seminar room for 15 to 20 people
- Access to weights/CV training equipment
- Area for waiting/resting players
- Residential accommodation for 20 people
- Office with telephone to accommodate two people
- Car parking\*\*

\*Note – Refer to Sport England Design Guidance Notes “Sports halls – Design”, “Sports halls – Sizes and Layouts” and “Changing Rooms and Lockers”. These are available free-to-download from:  
[http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)

\*\*Note – Refer to Sport England Design Guidance Note “Car Parking and Landscape Design”. This DGN is available free-to-download from:  
[http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)

## Section B Badminton Centres in Multi-use Halls

These centres would most likely be in sports centres, schools, academies or universities and may be classified as Performance and Development Centres or Development Centres

The advice given in these notes, by Sport England and BADMINTON England, will provide the best conditions for playing the game. Professional designers may consider that there are other ways of achieving the same results, and alternatives would be considered but these must first be approved by BADMINTON England and Sport England before commitment and construction.

### B1 - Flooring

- 1) The preferred flooring for playing badminton is a sprung floor covered with a vinyl absorbent covering. This being an area elastic floor covered with a point elastic covering, this being referred to as a floor with combi-elastic deflection. A description of this floor would be as follows:-

A combined area and point elastic sports floor covering comprising a 22mm thick plywood decking secured to preservative treated battens supported by shock absorbent cradles. The playing surface to comprise a 6.5mm thick close cell foam backed sheet floor covering. A more detailed Performance Specification for Badminton Flooring is set out at Appendix 1 of this Design Guidance Note.

- 2) The other type of sprung floor commonly used and accepted by BADMINTON England is a sprung floor covered with hardwood strip flooring.
- 3) The performance standard and testing method for sports floors is covered by British Standard 7044: Artificial Sports Surfaces, Part 4 – Specification for Surfaces for Multi-sports Use. This is a wide specification and BADMINTON England prefers to be more specific in the type of floor used.

- 4) In existing halls solid floors are often used i.e. concrete, screed or composition flooring. This is **NOT** acceptable for the playing of badminton and injuries can be caused with this type of floor. It is appreciated that existing centres and halls may have this type of floor and that they can be improved by covering the existing hard floor with laminated timber planks on rubber strips or a foam-backed cushioned sheet material. Halls modified in this manner would be an improvement but would not be considered for accreditation or for funding through Sport England. It should also be noted that this upgrade will not comply with Part 4 of the British Standard 7044 and therefore a detailed risk assessment will need to be carried out. Anything less than Part 4 is not suitable for the playing of badminton or other sporting and movement activities such as dance or aerobics. The insurance industry in the United Kingdom regards a floor specification which complies with BS7044 Part 4 as the minimum against which to defend a claim for a sports injury caused by the floor specification and workmanship. Therefore any upgrade specification which falls short of this leaves the facility owner or lessee at risk of a claim.
- 5) The finish to the flooring should be matt to avoid any glare and the overall effect dark in colour. The floor colours reflectance value should be within the range 20% to 40%.

### B2 - Space and layout

#### Schedule of court sizes

#### Height requirements

- 1) The heights indicated in the schedule are the minimum heights, which should be over the whole of the court area, and are below any obstructions such as beams, basketball backboards, cricket net rails and lights, etc.
- 2) Halls below 7.6m would be unsuitable for play at a high level (County or National) but would be adequate for local league or club

**Table 4 Schedule of court sizes, Development Centres – Minimum space around courts**

Hall size	Between courts	Between courts where curtain is required	Sides at end of hall	End of court
<b>Existing hall – height 6.7m</b>				
Length 32.00m	No curtain 1.52m		1.52m	1.50m
Width 16.40m	With curtain 1.40m	2.40m	1.20m	
<b>Recommended new-build hall – height 7.6m</b>				
Length 33.00m	No curtain 1.72m		1.72m	2.30m
Width 18.00m	With curtain 1.50m	2.60m	1.50m	

**Table 5 Schedule of court sizes, Performance and Development Centres – Minimum space around courts**

Hall size	Between courts	Between courts where curtain is required	Sides at end of hall	End of court
<b>Existing hall - height 7.6m (as development centres)</b>				
<b>New-build hall – height 9.1m</b>				
Length 33.00m	No curtain 1.72m		1.72m	2.30m
Width 18.00m	With curtain 1.50m	2.60m	1.50m	
<b>Recommended new-build hall size for tournaments and accommodating spectators – height 7.6m</b>				
Length 34.80m	No curtain 2.08m		2.08m	3.80m
Width 21.00m	With curtain 2.00m	2.90m	1.60m	
Notes:				
<ul style="list-style-type: none"> <li>● The dimension of 1.2m at the sides of the court is the recommended minimum and this must be maintained when a curtain is introduced.</li> <li>● The dimension of 2.4m between courts is the recommended minimum when a curtain divides the courts; this maintains the 1.2m at the sides of each court affected.</li> <li>● The dimension of 3.8m at the ends of the court is when additional space can be provided for spectators. In this situation it is more practical to provide 2.3m at one end and 4.3m at the other end for spectator seating, circulation and umpires/linesman's chairs.</li> <li>● BADMINTON England recognizes that not all existing halls will be able to provide the minimum dimensions but safety should be considered at all times. The applicant would need to carry out a detailed risk assessment.</li> </ul>				

matches as doubles is predominantly played rather than singles when the greater height would be desirable. It would also be suitable for Adult Education, recreational or children's' play.

- 3) A height of 6.1m is the recommended absolute minimum for small community centre halls designed only for recreational play.

### Layout of courts

- 1) Court markings should be 40mm wide and should be of a contrasting colour to the floor, but it is usual for these lines to be matt white; they may be applied by paint or tape. Where a sports centre is accredited by BADMINTON England then the badminton lines should be dominant.
- 2) Where the courts are laid out "end to end" then there must be a curtain between the ends of the courts and it is essential that the minimum dimension is maintained on both sides of the curtain (i.e. 1.5m and 2.3m). To avoid any distractions caused by movement and lights from the other courts, the curtain dividing the courts **should be solid**; netting will not be sufficient.

Note - Full details of the layout of a badminton court may be obtained on the Badminton England's website [www.badmintonengland.co.uk](http://www.badmintonengland.co.uk) (click on Development and then Facilities)



Figure 6 Hall/Spectator Gallery

## B4 - Walls and ceilings

### Walls

- 1) A background against which a fast moving shuttle can be seen easily is critically important for the successful playing of the game.
- 2) The ideal badminton hall has four plain walls with no windows or roof lights. There should be no distracting attachments, particularly brightly coloured items. Basketball practice backboards behind a court should be removable. There should be no ledges or other projections likely to trap shuttles.
- 3) Very careful thought should be given to the design of spectator galleries, these can sometimes create difficulties and distractions when viewed from the court. These areas need to be of similar colour to the walls and the lighting should be subdued and carefully hidden when viewed from the court. Windows and doors at the rear of the spectators' galleries should be curtained or designed so that no light can be seen from the court. If the spectator areas are glazed then specialist advice should be obtained from the Glazing Association so that no interference is caused by lights or reflection of activity from the playing area.

Note - Glass and Glazing Federation, 44, Borough High Street, London, SE1 1BX Tel: 0207 403 7177

- 4) Walls should be finished in medium to dark shades and have a matt surface. This applies just as much to sidewalls as to the end walls since many shots are played looking towards the side of the court. Walls can be built of many different types of material but it should be borne in mind that acoustics play an important part in the enjoyment of the hall. Colours with a reflectance value of 30-50% were found to give the best playing conditions - green (Dulux Colour dimensions code 30 GG 45/362) or an equivalent blue (86 BG 43/321). Any doors or coverings should be finished in the same colour as the walls. Please also refer to Sport England Design





**Figure 7** Note acoustic blocks have been used in the wall construction

Guidance “Sports Halls – Design” regarding reflectance values for walls and ceilings, etc which needs to be taken into account when selecting the most appropriate value.

Note - Sport England Design Guidance “Sports Halls – Design” is free-to-download from the Sport England website at [http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)

- 5) Where curtains are drawn at the ends of the courts, such as in a hall that has the courts laid out “end to end”, the material should be “solid” and the same colour as the surrounding walls.
- 6) The overall construction should be designed to provide sound absorption qualities with a **maximum** reverberation time of 2 seconds at 500Hz with a noise rating of 50.

### Ceilings

The ceilings in sports halls are often the underlining to the roof, which is a sandwich construction. The underlining can be of an acoustic material and as with the walls this is

very important to the environment of the hall. Sometimes the self-finished acoustic lining is an ideal colour for the ceiling and complies with the required reflectance values of 70–90% - colours in excess of 90% i.e. white, causes visual problems and should not be used.

## B4 - Environmental services

### Lighting

(Please also refer to paragraphs 1-12 in Section A)

In a multi-use hall where badminton is played the ideal conditions would be for the centre lights to be lowered to 5 metres on a rise and fall gantry system (allow sufficient cable for maintenance). If this is not possible then it is important that the switching should be arranged so that all the luminaires at the rear of the courts can be switched off, thereby creating a darker background. In this instance it is better to have five luminaires suspended between the courts and wired so that those at each end of the court can be switched off and the three centre luminaires left on for playing. This will give acceptable conditions where dedicated badminton lighting cannot be used.



**Figure 8** Note lights set in Badminton state (three luminaires only and lowered to 5 metres)



### Illuminance to BS EN 12193 (1999)

The level of illuminance required for many sports is influenced by the standard of play and is set out in BS EN 12193 (1999) as Class I, II and III. Notwithstanding this recommendation the level of illuminance required for badminton should be the best possible irrespective of standard. The illuminance plot, Figure 9 shows the recommended level.

BADMINTON England recognizes that the National Governing Body's recommendation for lighting is not in accordance with BS EN 12193. Nevertheless, experience gained over many years supports the recommendation that lighting for Badminton should be in accordance with the illuminance levels as shown at Figure 9. This diagram shows there is not a uniformity of lighting across the court but rather a higher level of lighting over the centre area of the court across the full width.

### Luminaires and glare control

- 1) The total elimination of glare in sport is seldom achieved due to the ever-changing directions of view of participants. Nevertheless measures should be taken in an attempt to minimise glare that may affect the visual performance of participants. To this end downlighter luminaires should be used that incorporate glare control.
- 2) In sporting environments similar to indoor working conditions, glare should be calculated using the unified glare rating (UGR) method and limiting values used shall be those specified in prEN 12464.

### Facilities for visually impaired/partially sighted participants

- 1) When visually impaired or partially sighted participants play sport (including badminton) increased illumination may improve their performance and enjoyment. However, depending upon the nature of the pathology of the participant, increased levels of illuminance may adversely affect the performance and enjoyment.

- 2) By using the high frequency fluorescent lighting systems described previously, court level illuminance values can be varied, typically between 50% and 150% of the normal design lighting requirement. For those participants without visual impairment, the illuminance level can be adjusted so as to provide a 100% output. Where variation from the normal illuminance level is required when visually impaired or partially sighted individuals are playing badminton, the light output from the installation can be controlled accordingly depending upon the pathology, and subsequent lighting requirements, of the participants. It will be evident that individuals with mixed visual abilities are unlikely to participate on the same court simultaneously.
- 3) In all situations it is essential to ensure conformity with the terms specified in the UK Disability Discrimination Act 1995 together with all other current relevant legislation.

Note – Please also refer to Sport England DGN "Access for Disabled people" which is free-to-download from: [http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)


Typical lux reading for a badminton court with ideal lighting conditions – luminaires to be 5 metres above floor level, 1 metre from the edge of the court and no luminaires extending more than 3 metres from the net line at the centre of the court.

### Heating and ventilation

- 1) The design temperatures should be between 16 to 19°C, which is accepted as the comfort zone for playing the game. It is recommended that no less than 1.5 air changes per hour be made.
- 2) Any heating or ventilating system that moves the air can deflect the shuttlecock therefore it is important that heating and ventilation systems are designed taking this into account. The location and protection of all air input and extraction grilles or

**Table 6 Illuminance levels**

ILLUMINANCE PLOT with luminaires at 5 m above floor level	
Average illuminance	474 lux
Minimum illuminance	305 lux
Maximum illuminance	595 lux

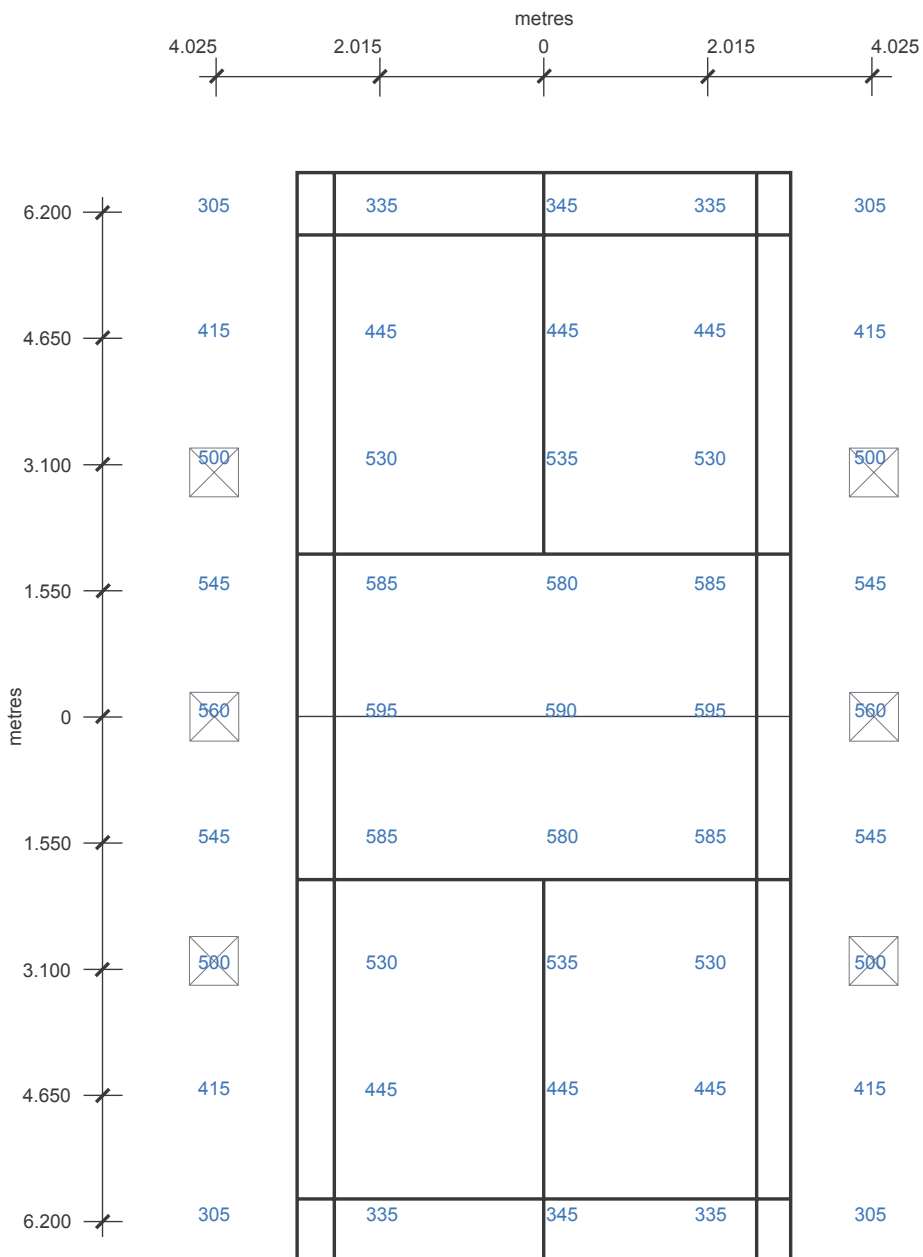

**Figure 9 Illuminance plot and luminaire positions**

openings must be carefully considered – particularly in relation to the flight path of the shuttlecock. It is better if ventilation systems are designed to operate around the perimeter of the hall to limit air movement over the court. The air velocities within the playing area should not exceed 0.1 metres per second.

- 3) The system most commonly used where badminton is played is high-level radiant panels fitted to the walls in conjunction with a controlled ventilation system. Traditional low pressure hot water radiator systems or under floor heating could be used if appropriate to the type of flooring. Heating by warm air is not recommended, as it is difficult to control the air movement when the heating is operating.

### Maintenance and monitoring

A programme of cyclic maintenance should be operated whereby: -

- Luminaires shall be cleaned at a frequency in keeping with the activities performed within the environment.
- Lamps should be changed in accordance with manufacturers' recommendations
- Records shall be kept of maintenance performed
- Individually failed lamps shall be replaced as a matter of urgency – since an inoperative luminaire will present a 'dark patch' when players are looking upwards which is likely to result in difficulty in following the trajectory and velocity of the shuttle.

### B5 - Other accommodation and facilities

Badminton does not require large storage facilities for equipment only sufficient room for wheel-away posts, nets and shuttles. However, in multi-use halls, the general minimum storage provision for all sports activities must be equivalent to 12.5% of the hall floor area. This minimum provision should be increased where community use and storage requires it. In a

single-court hall with community use, a minimum of 45 square metres storage is required.

Other facilities required for **Development Centres** as follows:-

- Changing rooms with showers for both male and female\*.
- Catering - Basic i.e. vending.
- On site first aid.
- Provision for hire of playing equipment.
- Car parking\*\*.

\*Note – Refer to Sport England Design Guidance Notes "Sports halls – Design", "Sports halls – Sizes and Layouts" and "Changing Rooms and Lockers". These are available free-to-download from:  
[http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)

\*\*Note – Refer to Sport England Design Guidance Note "Car Parking and Landscape Design". This DGN is available free-to-download from:  
[http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)

Other facilities required for **Performance and Development Centres** as follows:

- As for a Development Centre

In addition:

- Physio/medical room.
- Meeting/seminar room for 15 to 20 people.
- Access to weights/CV training equipment.
- Area for waiting/resting players.

**Appendix 1**
**Table 7 Performance specification for badminton flooring**

<b>Description</b>	Combined area and point elastic sports floor covering comprising a 22mm thick plywood decking secured to preservative treated battens supported by shock absorbent cradles. The playing surface to comprise a 6.5mm thick closed cell foam-backed sheet floor covering.	
<b>Total finished thickness</b>	Not to exceed 85mm	
<b>Property</b>	<b>Test/Reference</b>	<b>Specification</b>
Fire Rating	prEN 11925	C
Dimensional Stability	EN 434	0.10%
Colour Fastness	EN20-105 B02	≥6
Anti-Bacterial/ Fungicidal Treatment		Yes
Chemical Resistance	EN 423	Resistance to dilute acids, oil, alkalis, grease and cleaning agents except vinyl solvents.
Friction Coefficient	prEN [German Method]	0.45
Wear Layer	UV Reticulated PU Surface Treatment	Yes
Shock Absorption	BS 7044: Part 4	≤ 200G
Energy Return	EN [%]	≥ 50%
Abrasion Resistance	EN 660	≤ 0.2g
Dynamic Load Limit	prEN 1569 (N)	≤ 1500
Indentation Resistance	prEN 1516 (mm)	≤ 0.5
Static Load Limit	psi	≤ 200
Dynamic Load Limit	psi	≤ 1500
Evenness	prEN 13036.7 (mm)	≤ 6
Light Reflection	ISO 2813 (%)	≤ 30

## Further reference

### Sport England Design Guidance Notes:

*Access for Disabled People*

*Sports Halls – Design*

*Sports halls – Sizes and Layouts*

*Car Parking and Landscape Design*

The above are all free-to-download from:  
[http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)

### The National Badminton Facilities Strategy 2000-2005:

(Summary Report price £3.00).

Further information may be obtained from  
The Badminton Association of England Ltd.,  
Development Department,  
National Badminton Centre,  
Bradwell Road, Loughton Lodge,  
Milton Keynes MK8 9LA.

Tel: 01908 268400  
Fax: 01908 268412,

Email: [enquiries@badmintonengland.co.uk](mailto:enquiries@badmintonengland.co.uk).

Website: [www.badmintonengland.co.uk](http://www.badmintonengland.co.uk)

### BS 7044: Part 4

(Please note this document is currently being reviewed and a further update is anticipated during 2005. It is understood this will result in a harmonisation between the British Standard and the CEN 217 requirements)

### CEN 217

### Addendum to CIBSE Lighting Guide 4: Sports, 1990, issued February 2000

(Please note this document is currently being reviewed and a further updated document is anticipated during 2005)

## Design Guidance Prepared by

Roger A Barnard BA [Hons] BArch RIBA MCMI  
MInstPS  
Architect  
Community Investment  
Operations and Performance Directorate  
Sport England  
3rd Floor  
Victoria House  
Bloomsbury Square  
London WC1B 4SE  
Tel: 020-7273 1584  
Email: [roger.barnard@sportengland.org](mailto:roger.barnard@sportengland.org)

## Acknowledgements

### John Bristow

BADMINTON England,  
Development Department,  
National Badminton Centre,  
Bradwell Road,  
Loughton Lodge,  
Milton Keynes MK8 9LA.

Tel: (+44) 01908-268400

Email: [enquiries@badmintonengland.co.uk](mailto:enquiries@badmintonengland.co.uk)

### Dr N A Smith

Sports Lighting Consultancy

Tel: (+44) 01302-782514

Email: [nasmith@freeuk.com](mailto:nasmith@freeuk.com)

### Saville Jones Architects

74 Victoria Road  
Worthing  
West Sussex BN11 1UN

Tel: 01903 211363

Email: [mail@savillejones-architects.com](mailto:mail@savillejones-architects.com)

## Colleagues at Sport England Support Centre and Regional Offices

### **Sport England Disclaimer**

When referring to or otherwise using Sport England Design Guidance you should always download your reference at the time of use in order to ensure that you are referring to the most up-to-date information. Amendments, alterations and updates to Guidance documents may take place at any time without prior Notice or detailed indication of the changes made. You should therefore always discard copies of the Guidance Notes once you have referred to them, and download or refer to the latest version at a future date when the need arises. No responsibility will therefore be accepted for the consequences of working to previous or out-of-date versions of Sport England's Design Guidance Notes.

Client organisations, their representatives or advisors, should not view the Design Guidance as a substitute for obtaining comprehensive expert or professional advice in relation to their specific Conditions of the projects and applications for Lottery and other funding.

Whilst every effort has been made to ensure the accuracy of the Design Guidance and all information contained herein, Sport England, its servants or agents shall not at any time, in any circumstances, be held responsible or liable to any applicant or any other party in respect of any loss, damage or costs of any nature arising directly or indirectly from reliance placed on the information contained within this Design Guidance or any other Design Guidance or policies issued by Sport England.

---

### **Notes**

The term Design Guidance Note should be taken to imply the minimum standards required to produce best practice solutions acceptable to Sport England which in turn may enable funding to be provided. There may be occasions where these standards need to be reviewed to take into account project specific conditions. Applications for relaxation of the standards will be considered only with an accompanying reasonable justification. Relaxations will be exceptional. Relaxations will only be at the discretion of Sport England Architects, Community Investment, Support Centre, 3rd Floor, Victoria House, London WC1B 4SE who are responsible for Strategic Design Policy.

A full set of Design Guidance Notes is available from the Sport England website at:

[http://www.sportengland.org/index/get\\_resources/resource\\_downloads/design\\_guidelines.htm](http://www.sportengland.org/index/get_resources/resource_downloads/design_guidelines.htm)

or

Sport England Publications  
PO Box 255, Wetherby LS23 7LZ

Tel: 0990 210255

Fax: 0990 210266



Sport England is the Brand name of the English Sports Council which is the distributor of the Sport England Lottery Fund

Design concept by GDA Creative Solutions

Produced by NBA Tectonics

Printed in England by Webmaster, Dominic Moore, Sport England

Tel: 020 7272 1788

Email: [dominic.moore@sportengland.org](mailto:dominic.moore@sportengland.org)